Portland General Electric

OASIS Posted Paths

Posted: January 12, 2018

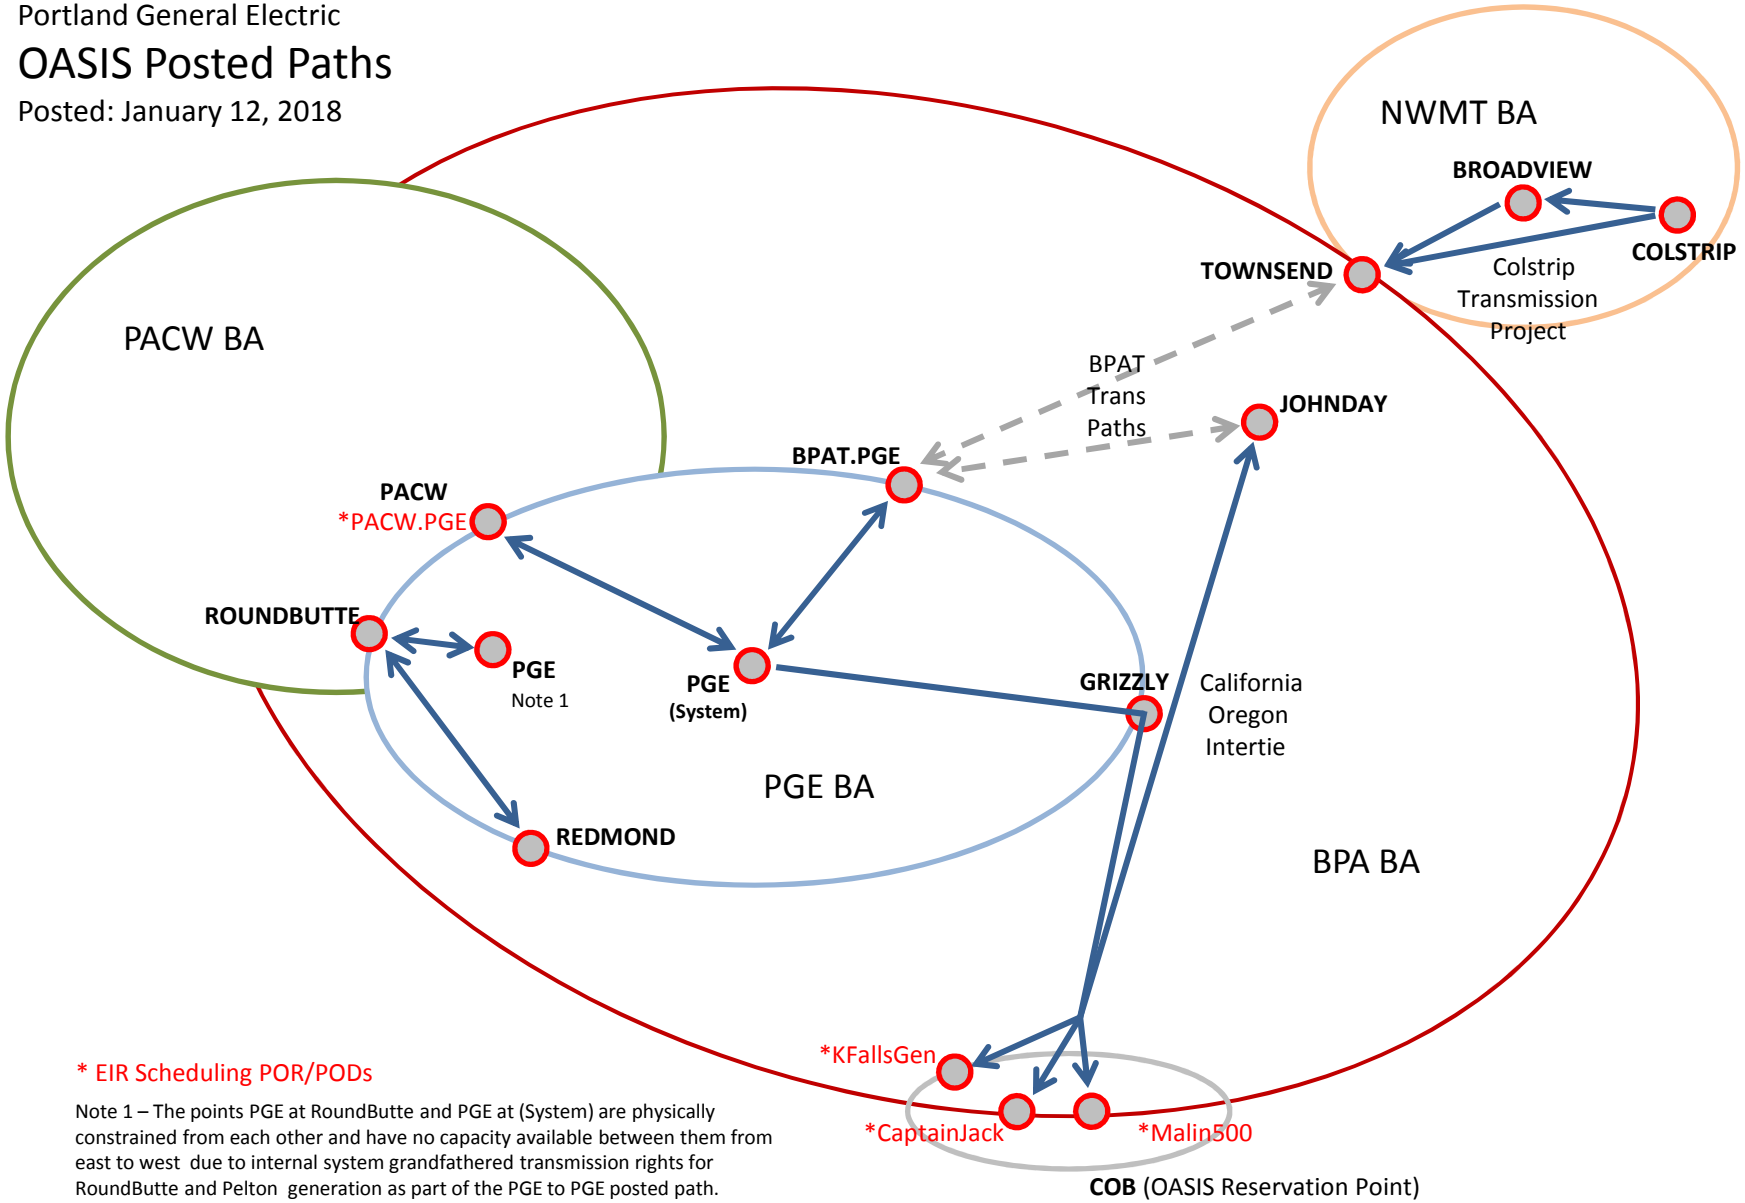

* EIR Scheduling POR/PODs

Note 1 – The points PGE at RoundButte and PGE at (System) are physically constrained from each other and have no capacity available between them from east to west due to internal system grandfathered transmission rights for RoundButte and Pelton generation as part of the PGE to PGE posted path.