


Approximate Geographic Locations of MTDT Constraints (August 2005)

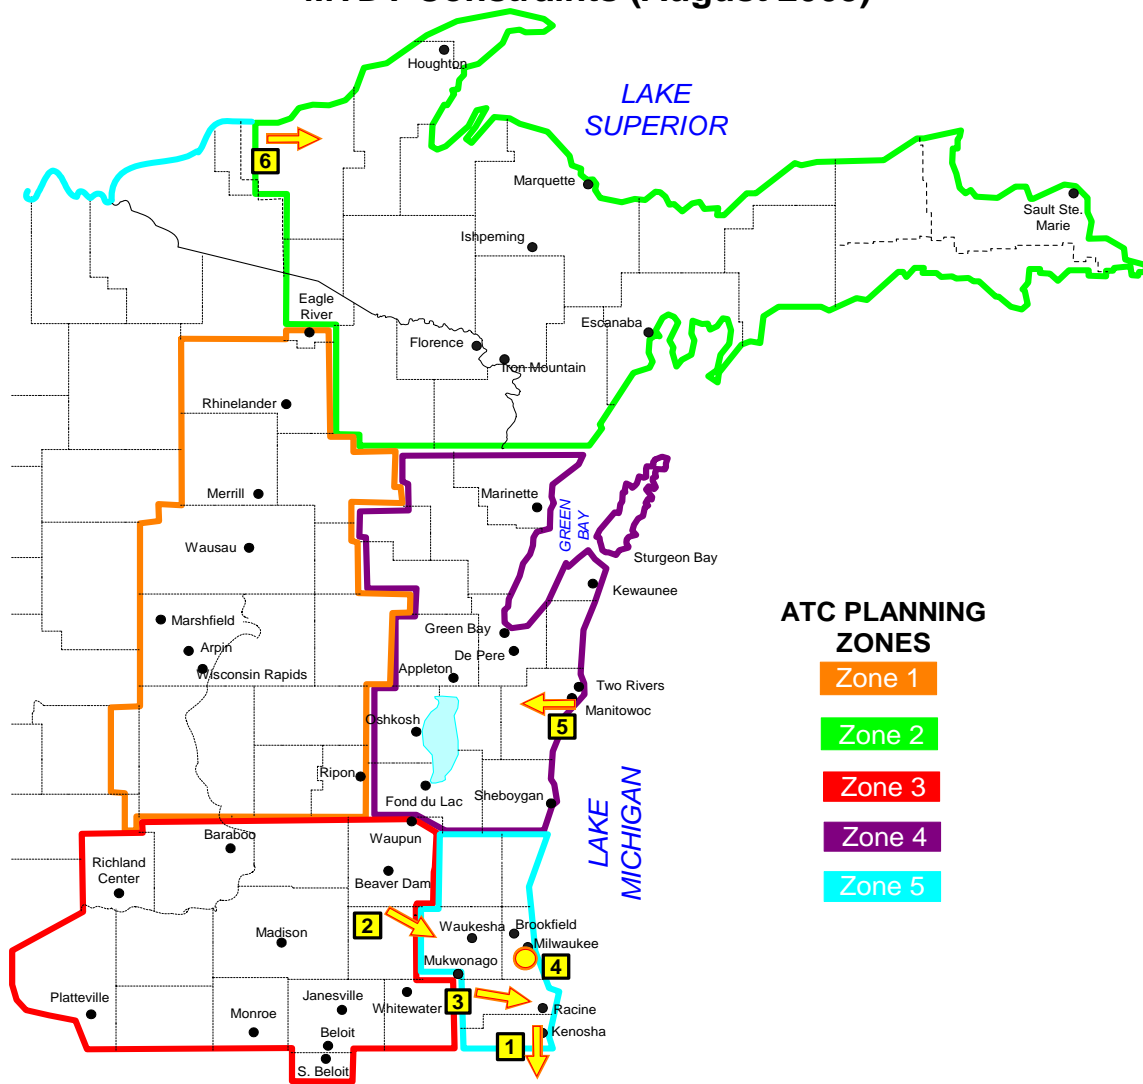

Limiting Branch	MW Restricted in MTD	Map Ref. Number*
Bain-Kenosha 138kV	898	1
Kenosha-Lakeview 138kV	817	
Lakeview-Zion 138kV	422	
Concord-Rockvale 138kV	246	2
Rockvale-Cooney 138kV	158	
Paris-Albers 138kV	168	3
Oak Creek 230/138kV Transformer	166	4
Oak Creek 230kV Bus Tie	72	
Custer-Manrap 69kV	48	5
Lakefront-Revere 69kV	24	
Ontonagon 69/138 kV Transformer	30	6
Victoria-Ontonagon 69kV	24	
Victoria-Rockland 69kV	14	
Rockland-Mass 69kV	13	
White Pine-Tollfree-Victoria 69kV	11	
Mass-Lake Mine 69kV	9	
Lake Mine-Winona 69kV	4	

* Map shows approximate geographic locations of limiting elements as well as direction of constrained flow in the MISO Market Transition Deliverability Test (MTDT).